




# PROPANE TANK SETBACKS

## For Above Ground ASME Containers

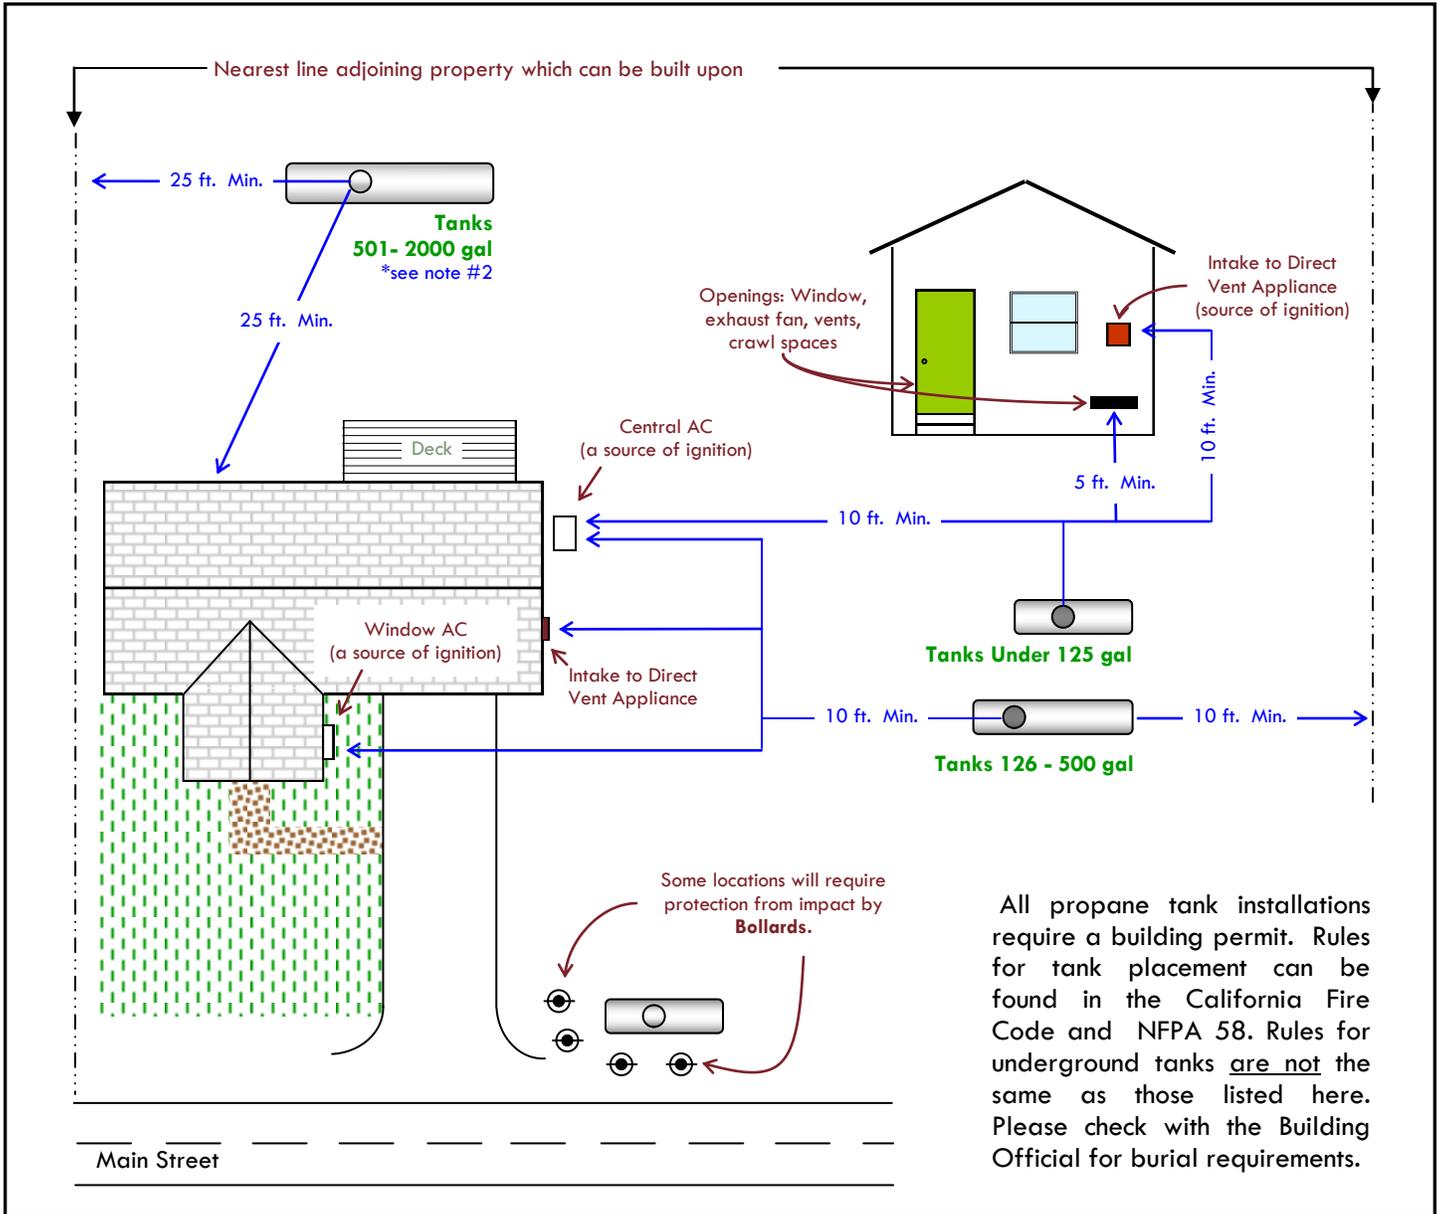

### Notes:

- 1) Regardless of its size, any ASME tank filled on-site must be located so that the filling connection and the fixed liquid level gauge are at least 10 ft from external source of ignition (i.e. open flame, window A/C, compressor, water heater, etc.) intake to direct vented gas appliance, or intake to a mechanical ventilation system.
- 2) Setback may be reduced to 10 ft minimum for a single container of 1200 gallons water capacity or less if it is located at least 25 ft from any other LP Gas container of more than 125 gallons water capacity.
- 3) Where the container may be subject to abrasive action or physical damage due to vehicular traffic or other causes it must be:
  - a) placed not less than 2 feet below grade or
  - b) protected against such physical damage with bollards or similar protective device.