





T-FOUNDATION

Typical design details you'll need to provide for your footings.



Napa County is mostly in Seismic Category D

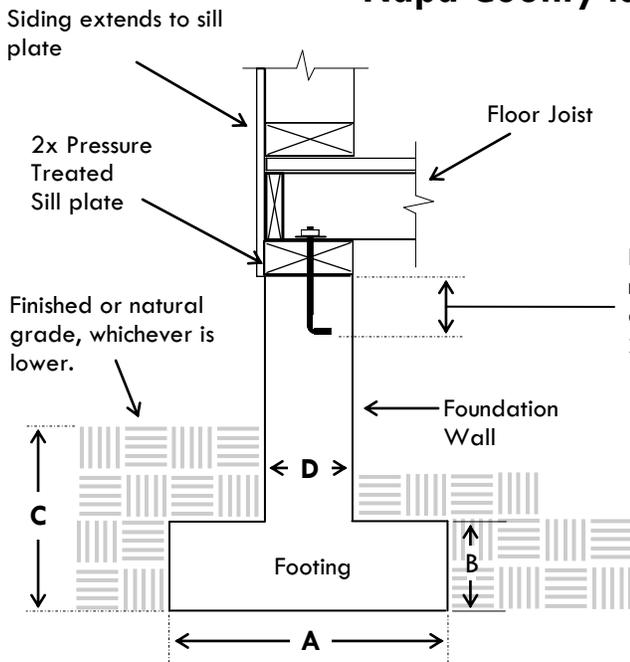

Bolt must have 7 inch minimum embedment. 5/8 in diameter anchor bolt with a 2 x 2 x 3/16 inch square washer.

Number of Floors And Foundation Size

Story	A FTG Width	B FTG Height	C Depth	D Wall Width
1	12"	6"	12"	6"
2	15"	7"	18"	8"
3	18"	8"	24"	10"

Concrete or Masonry Foundation

Bolt Locations

Bolts at ends to be located not more than 12 inches or less than 7 bolt diameters from end of each sill plate.

