


VICINITY MAP

TURNAROUND LOCATED WITHIN 50.0' OF EACH STRUCTURE

MINIMUM 100 FEET OF DEFENSIBLE SPACE REQUIRED AROUND ALL STRUCTURES - TYP

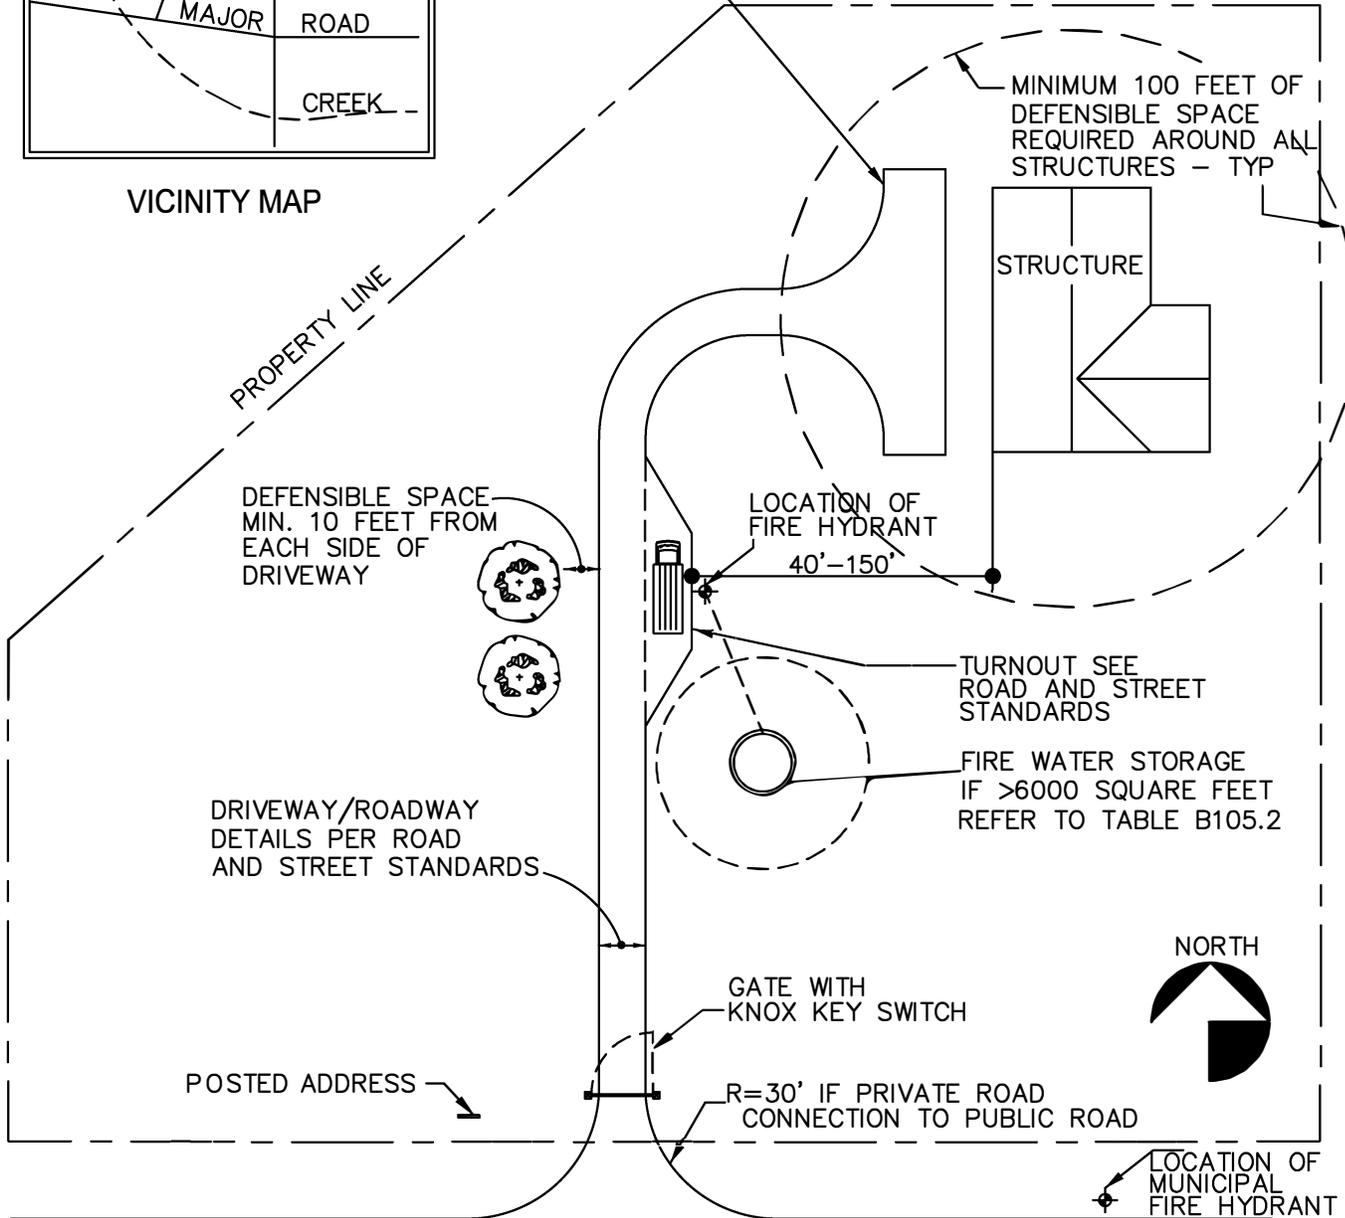

DEFENSIBLE SPACE MIN. 10 FEET FROM EACH SIDE OF DRIVEWAY

LOCATION OF FIRE HYDRANT 40'-150'

TURNOUT SEE ROAD AND STREET STANDARDS

FIRE WATER STORAGE IF >6000 SQUARE FEET REFER TO TABLE B105.2

DRIVEWAY/ROADWAY DETAILS PER ROAD AND STREET STANDARDS

GATE WITH KNOX KEY SWITCH

POSTED ADDRESS

R=30' IF PRIVATE ROAD CONNECTION TO PUBLIC ROAD

NORTH



LOCATION OF MUNICIPAL FIRE HYDRANT

ROAD NAME

RESIDENTIAL SAMPLE SITE PLAN

FIRE SAFE STANDARDS

**CAL FIRE**  
Napa County Fire Department

DATE: FEBRUARY 2016

REVISED: 01/2018

APPROVED