


WATER TANK NOTES

- NO BUILDING PERMIT IS REQUIRED FOR WATER TANKS SUPPORTED DIRECTLY ON GRADE IF IT IS LESS THAN 5,000 GALLONS AND THE RATIO OF HEIGHT TO DIAMETER OR WIDTH DOES NOT EXCEED 2:1. FOR TANKS THAT DO NOT MEET THE ABOVE A BUILDING PERMIT AND CONCRETE FOUNDATION IS REQUIRED.

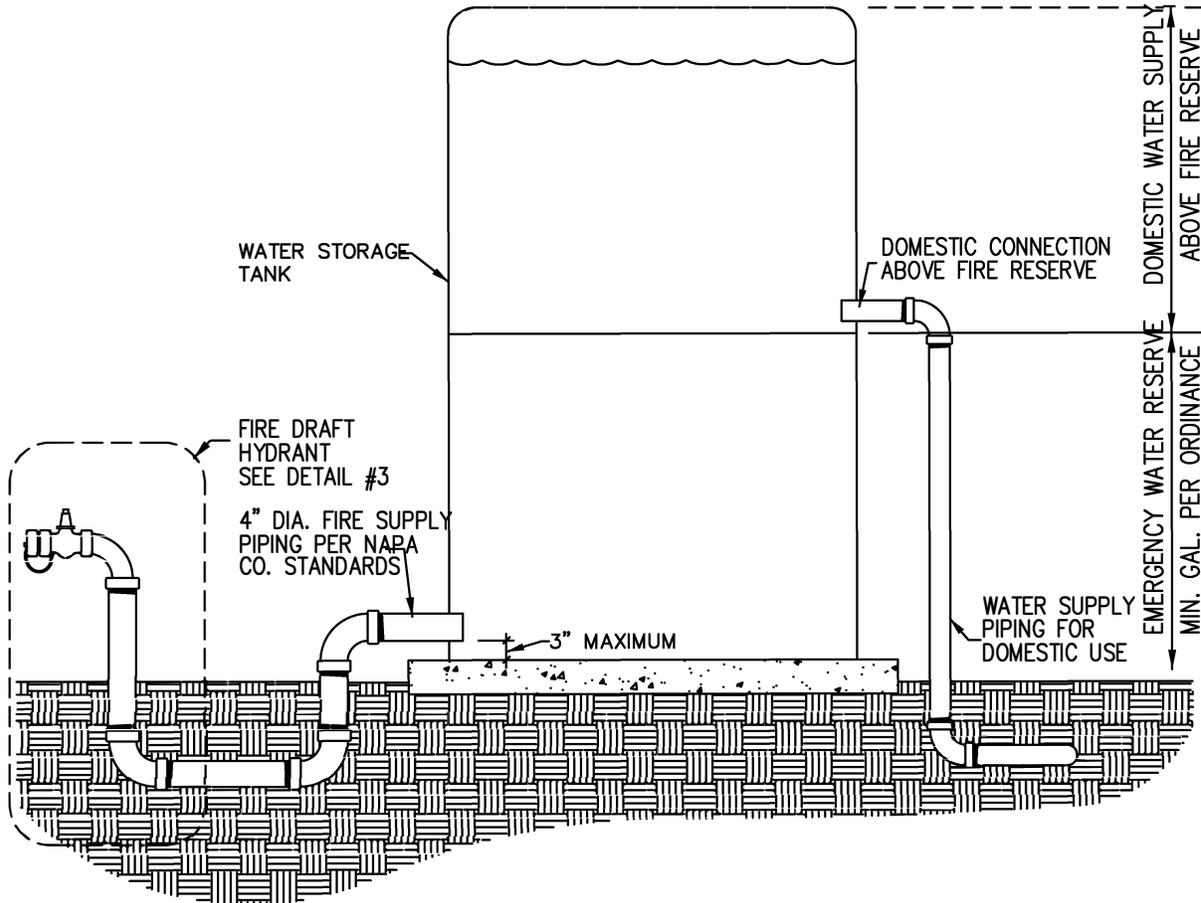

WATER STORAGE TANK

WATER SUPPLY NOTES

- FOR WATER TANK STORAGE CAPACITY REQUIREMENTS REFER TO NAPA COUNTY AMENDMENTS TO C.F.C. 2016
- WHEN MULTIPLE WATER TANKS ARE UTILIZED TO ACHIEVE THE REQUIRED VOLUME OF WATER, THE CONNECTION BETWEEN THE TANKS SHALL BE BY AN APPROVED 4" DIA. WATER LINE.

RESIDENTIAL WATER SUPPLY FROM TANK

FIRE SAFE STANDARDS

CAL FIRE
Napa County Fire Department

DATE: FEBRUARY 2016
REVISED: 01/2018
APPROVED

4