

- ✦ FOR STORAGE CAPACITY REQUIREMENTS REFER TO COUNTY OF NAPA AMENDMENTS TO C.F.C. 2007
- ✦ WHEN MULTIPLE TANKS ARE UTILIZED TO ACHIEVE THE REQUIRED VOLUME OF WATER, THE CONNECTION BETWEEN THE TANKS SHALL BE BY AN APPROVED 4" DIA. WATER LINE


**RESIDENTIAL WATER SUPPLY FROM TANK**

**FIRE SAFE STANDARDS**

**CAL FIRE**  
 Napa County Fire Department  
 1199 BIG TREE ROAD  
 ST. HELENA, CALIFORNIA 94574  
 OFFICE PHONE (707) 967-1419 FAX (707) 967-1474

NOT TO SCALE	<b>4</b>
SCALE	
---	
REVISION DATE	DRAWING NO. 4



## RESIDENTIAL DRAFT FIRE HYDRANT DETAIL (FROM TANK)

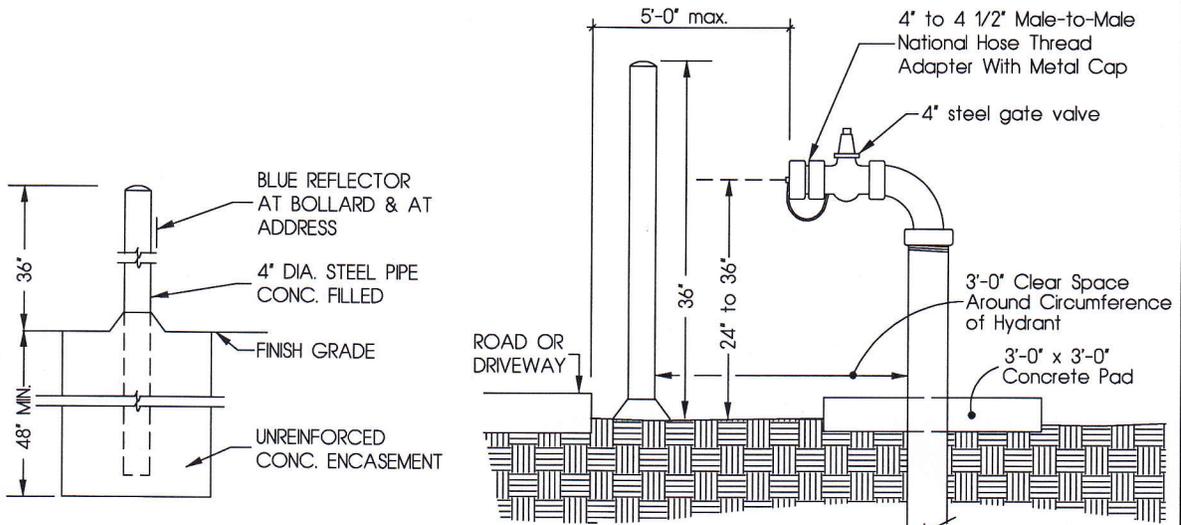

**GUARD POST/ BOLLARD**

### FIRE HYDRANT NOTES

- All Draft Fire Hydrants shall be "Wet"
- Show location of fire hydrant connection located within 150 feet of residence but no closer than 30 feet.
- Hydrant shall not be obscured by vegetation or structures.
- Water storage required for domestic purposes shall be in addition to the required storage for fire protection and all pipes or valves required for domestic purposes shall be installed on the tank above the level required for Fire Protection.
- A blue dot reflector shall be located adjacent to Hydrant.
- Fire hydrant connection shall be located within 5 feet of the driveway. Hydrant shall be located to so as not to block egress and ingress to and from the residence. Provide a turnout at that location if needed.
- Fire hydrant shall be painted "RED" and Signage posted on it to read "Wet Draft" in minimum of one inch high "WHITE" letters.

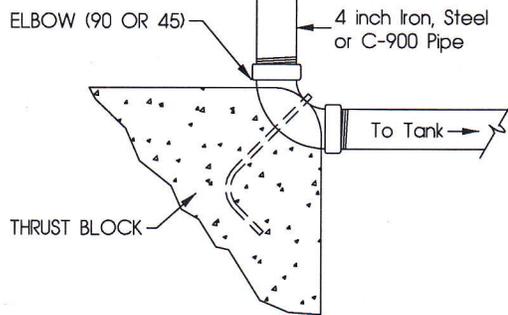

**HYDRANT & BOLLARD  
TYPICAL SPACING**

### RESIDENTIAL DRAFT FIRE HYDRANT DETAIL

#### CAL FIRE

Napa County Fire Department  
1199 BIG TREE ROAD  
ST. HELENA, CALIFORNIA 94574  
OFFICE PHONE (707) 967-1419 FAX (707) 967-1474

### FIRE SAFE STANDARDS

3/4" = 1'-0"	2
SCALE	
--	
REVISION DATE	DRAWING NO. 2